

SURE-LITES

Cat #EMS-277 Relay Accessory Switching Kit, 277 VAC

FOR USE ONLY WITH SURE-LITES CAT #H7891-EM, H7691-EM and H274-EM RECESSED EMERGENCY DOWNLIGHTS WHEN SWITCHING IS REQUIRED ON 277 VAC SUPPLY.


IMPORTANT SAFEGUARDS

WHEN USING ELECTRICAL EQUIPMENT, BASIC SAFETY PRECAUTIONS SHOULD ALWAYS BE OBSERVED INCLUDING THE FOLLOWING:

READ AND FOLLOW ALL SAFETY INSTRUCTIONS

1. **INSTALLING**—Turn off AC power to the fixture. Disconnect the Molex Connector. Remove the outer junction box cover (furthest from the fixture) and install the EMS-277 Kit in its place.
2. This accessory is intended to switch the fixture lamps in the *Normal AC Mode Only*. DO NOT switch the 277V supply which maintains emergency circuit charging and electronic control.
3. Do not use this equipment for other than its intended use.
4. Install only in accordance with National Electric Code and Local Regulatory Agencies requirements.
5. Installation and servicing to be performed only by qualified personnel

SAVE THESE INSTRUCTIONS

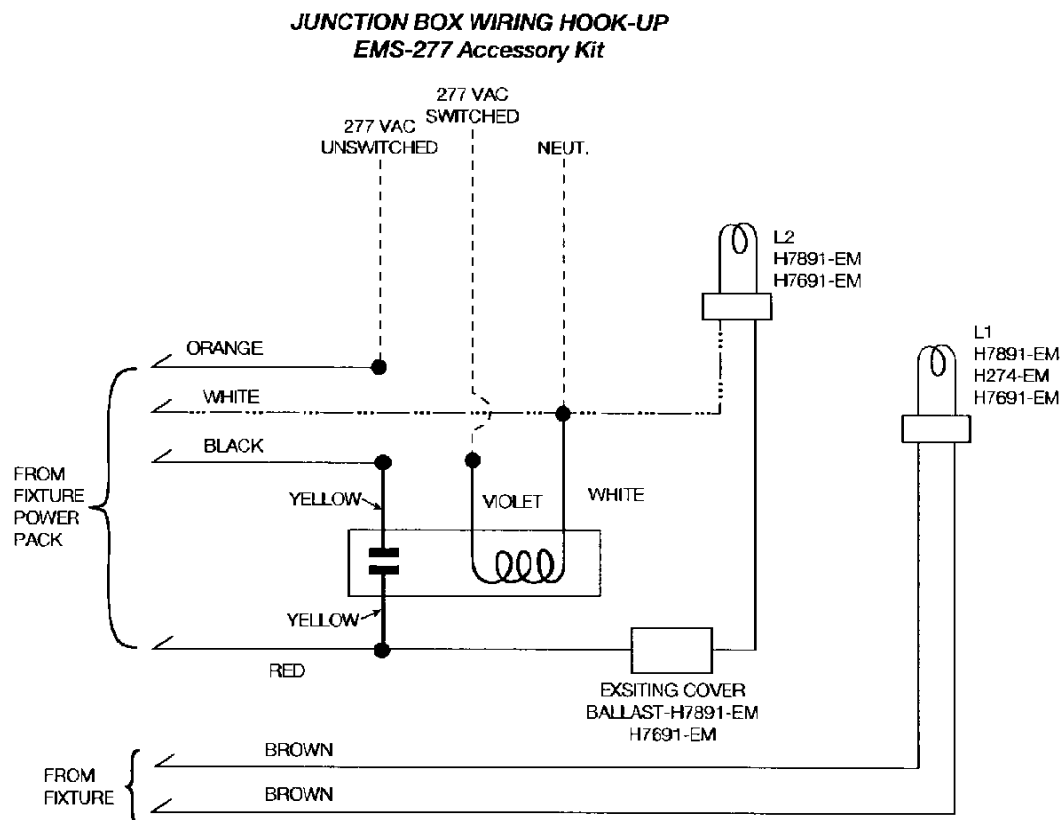

Cooper Lighting

SURE-LITES 400 BUSSE ROAD ELK GROVE VILLAGE, IL. 60007 695472