

1SPAX, 2SPAX, SN1P, AND SN2P INSTALLATION INSTRUCTIONS

WARNING: Before proceeding, read all instructions carefully to ensure proper and safe installation.

WARNING: Risk of fire or electrical shock. Disconnect power before installing or servicing.

WARNING: Risk of electrical shock. High temperatures inside luminaire. Make certain line voltage corresponds with ballasts primary voltage. (See ballast label)



WARNING: All wiring to be performed by National Electrical Code and local code by a qualified electrician.

WARNING: Make sure lamps are properly seated and oriented in sockets before energizing the circuit. Fixture may become damaged by improper lamp installation voiding warranty.


IMPORTANT: When lamping, always wear eye protection. Make sure area below fixture is clear.

NOTE: If lamp is installed dirty, operating hours and performance will significantly decrease.

IMPORTANT: Not every unit is identical. Placement of proper luminaire section (by length, emergency option, etc.) within each row is important. Refer to layout drawing to verify row identification, product location, and feed points.

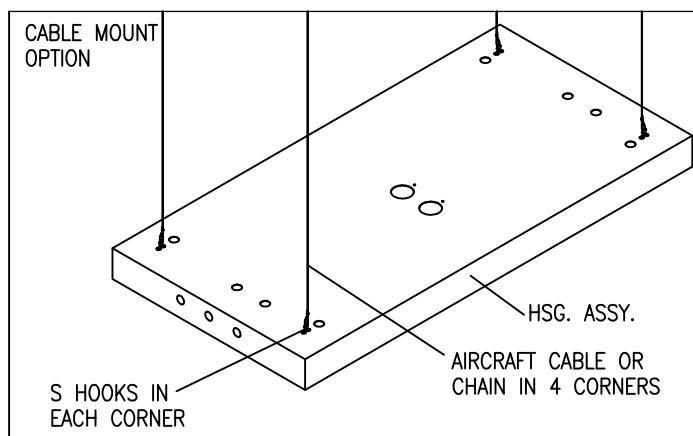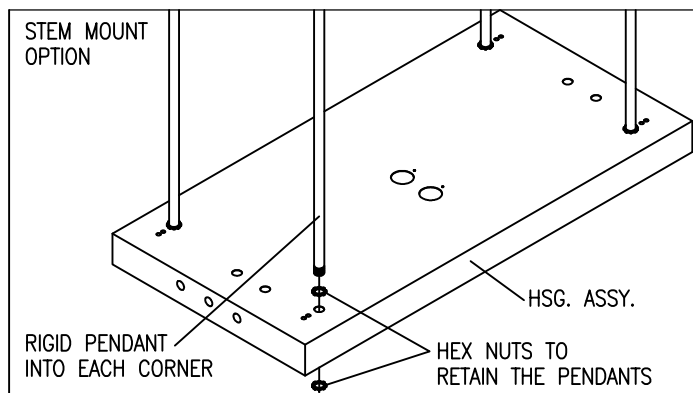

SURFACE MOUNT WITH (4) 1/4 20 SCREWS AND WASHERS TO A REINFORCED CEILING

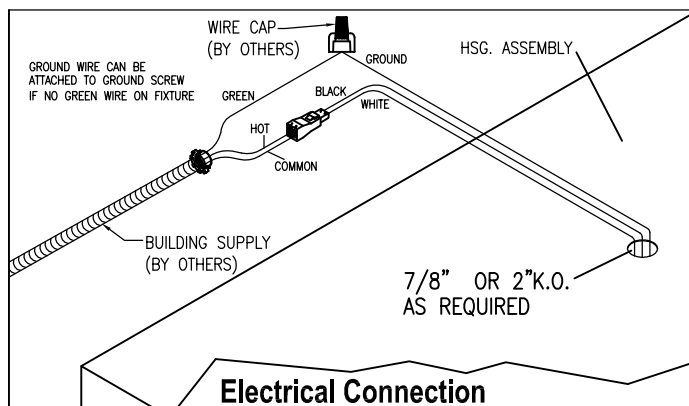

A Company with a Smart Vision

LSI LIGHTING INC.
10000 ALLIANCE ROAD
CINCINNATI, OHIO 45242
(513) 793-3200 FAX. (513) 984-0147
email: lsi-industries.com

Installation Questions?
Call LSI Field Service Department at:
1-800-436-7800 Ext. 3300 Fax. 877-861-1368

03-01-2012

Page 1 of 1
P# 488258