

S SDL LED INSTALLATION AND ASSEMBLY INSTRUCTIONS

SMARTVISION®

CAUTION: Risk of shock. Disconnect power before installing or servicing.

WARNING: Before proceeding, read all instructions carefully to insure proper and safe installation.

WARNING: Risk of electrical shock. High temperatures inside luminaire. Make certain line voltage corresponds with ballast/driver primary voltage (see ballast/driver label).

WARNING: All wiring to be performed per National Electrical Code and local code by a qualified electrician.

IMPORTANT: Not every unit is identical. Placement of proper luminaire is important. Refer to layout drawing to verify location identification, product location, and feed points.

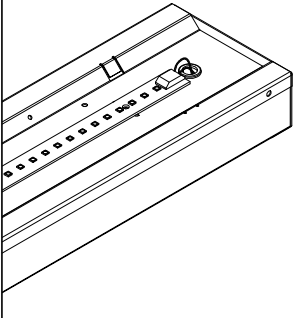
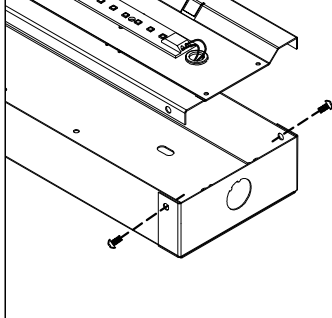
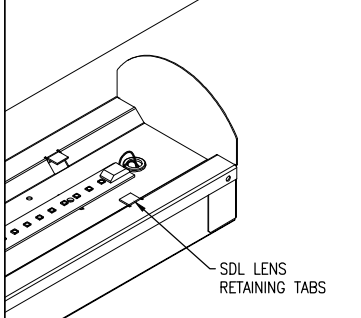
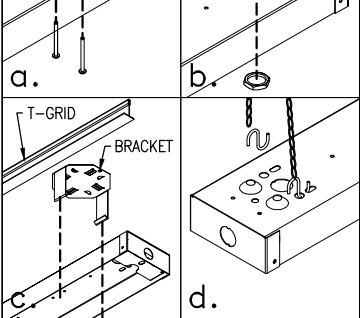
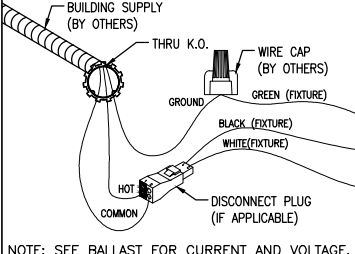
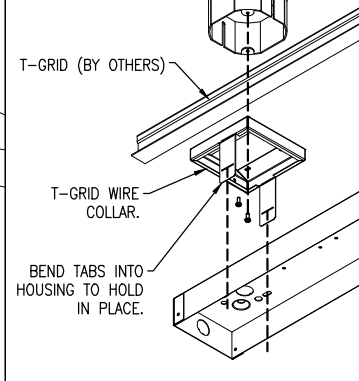
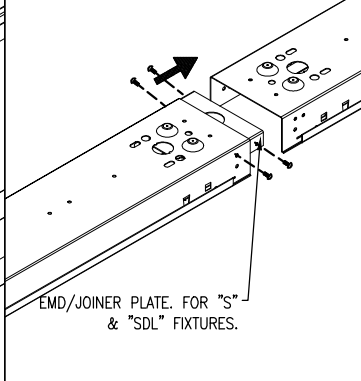
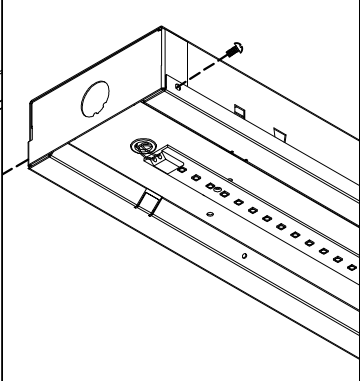
IMPORTANT: Do not electrically connect to live wiring.



Installation Questions?
Call LSI Field Service Department at:
1-800-436-7800 Ext. 3300 Fax 877-861-1368

LSI Industries Inc. ♦ 10000 Alliance Road ♦ Cincinnati, OH 45242 ♦ 513-793-3200 ♦ Fax (513) 793-0147 ♦ www.lsi-industries.com

S SDL LED INSTALLATION AND ASSEMBLY INSTRUCTIONS

			
<p>1.) UNPACK STRIP.</p>	<p>2.) TO INSTALL FIXTURE COVER NEEDS TO BE REMOVED BY REMOVING SCREWS THAT SECURE COVER TO HOUSING.</p>	<p><u>SDL FIXTURE OPTION:</u> SQUEEZE LENS ON SIDES TO UNCLIP FROM COVER.</p>	<p>3.) MOUNT/SUPPORT FIXTURE. a.) SCREWS (BY OTHERS). b.) STEM (ORDERED SEPARATELY). c.) GRID CLIP (ORDERED SEPARATELY). d.) CHAIN (ORDERED SEPARATELY).</p>
 <p>NOTE: SEE BALLAST FOR CURRENT AND VOLTAGE.</p>			
<p>4.) SEE WIRE DIAGRAM FOR WIRING CONNECTIONS.</p> <ul style="list-style-type: none"> HOT LEAD TO BLACK COMMON LEAD TO WHITE GROUND LEAD TO GREEN 	<p><u>T-GRID COLLAR OPTION:</u> ATTACHED J-BOX TO T-GRID AND FASTEN WIRE COLLAR TO J-BOX TO SECURE TO GRID SYSTEM. HOLD FIXTURE UP TO COLLAR AND BEND TABS TO HOLD IN PLACE. MAKE WIRE CONNECTIONS.</p>	<p><u>ROW MOUNTING OPTION:</u> HOUSING END CAN BE ROTATED 90 DEGREES TO BE USED AS JOINER AS SHOWN ABOVE.</p>	<p>5.) REPLACE COVER AND REATTACH WITH SCREWS. IF APPLIES REPLACE LENS ON COVER TO HOOK ONTO COVER TABS. FIXTURE IS INSTALLED AND CAN BE ENERGIZED.</p>



Installation Questions?
Call LSI Field Service Department at:
1-800-436-7800 Ext. 3300 Fax 877-861-1368