



A WATTS Brand

# S19-212 Pedestal-Mount Eye/Face Wash Unit

## Key Features

- Complies with American National Standard Z358.1
- Galvanized steel pipe and fittings with BradTect® safety yellow coated cast iron floor flange
- Universal identification sign and inspection tag included
- Full, one-year warranty
- Classified by Underwriters Laboratory Inc. to ANSI Z358.1

## Specifications

Unit design saves space and fits easily into any work environment. Eye/face wash operates quickly by a large, highly visible push handle. Safe, steady water flow under varying water supply conditions from 30–90 psi is assured by integral flow control in the sprayhead assembly. The ANSI Z358.1 standard requires an uninterrupted supply of flushing fluid at a minimum 30 psi flowing pressure. Eye/face wash sprayheads contain an antimicrobial agent to protect the sprayheads.



*This plumbing fixture is not intended to dispense water for human consumption through drinking or for preparation of food or beverages.*

## Standard Equipment

### Eyewash Bowl

10" (254 mm) diameter yellow impact-resistant plastic.

### Standard Sprayhead Assembly

Twin perforated-disc eye/face wash heads with protective sprayhead covers. Safe, steady water flow under varying water supply conditions from 30–90 psi is assured by integral flow control in the sprayhead assembly.

### Valve

Chrome-plated brass ½" NPT stay-open ball valve. Hand operated by a large, highly visible safety yellow PVC push handle.

### Pipe and Fittings

Galvanized steel pipe and fittings with BradTect® safety yellow coated cast iron floor flange.

### Waste

1¼" drain fitting furnished.

### Water Supply

½" NPT.

## Product Compliance

- Classified by Underwriters Laboratory Inc., to ANSI Z358.1




Model	Description
S19-212	Pedestal-Mount Eye/Face Wash Unit with Plastic Bowl

## Recommended Option:

[Navigator S19-2000 EFX8  
Emergency Thermostatic Mixing Valve](#)

NAVIGATOR



Satisfies ANSI Z358.1  
tepid water requirements.




A WATTS Brand

## S19-212 Pedestal-Mount Eye/Face Wash Unit

### Dimensions

(mm)

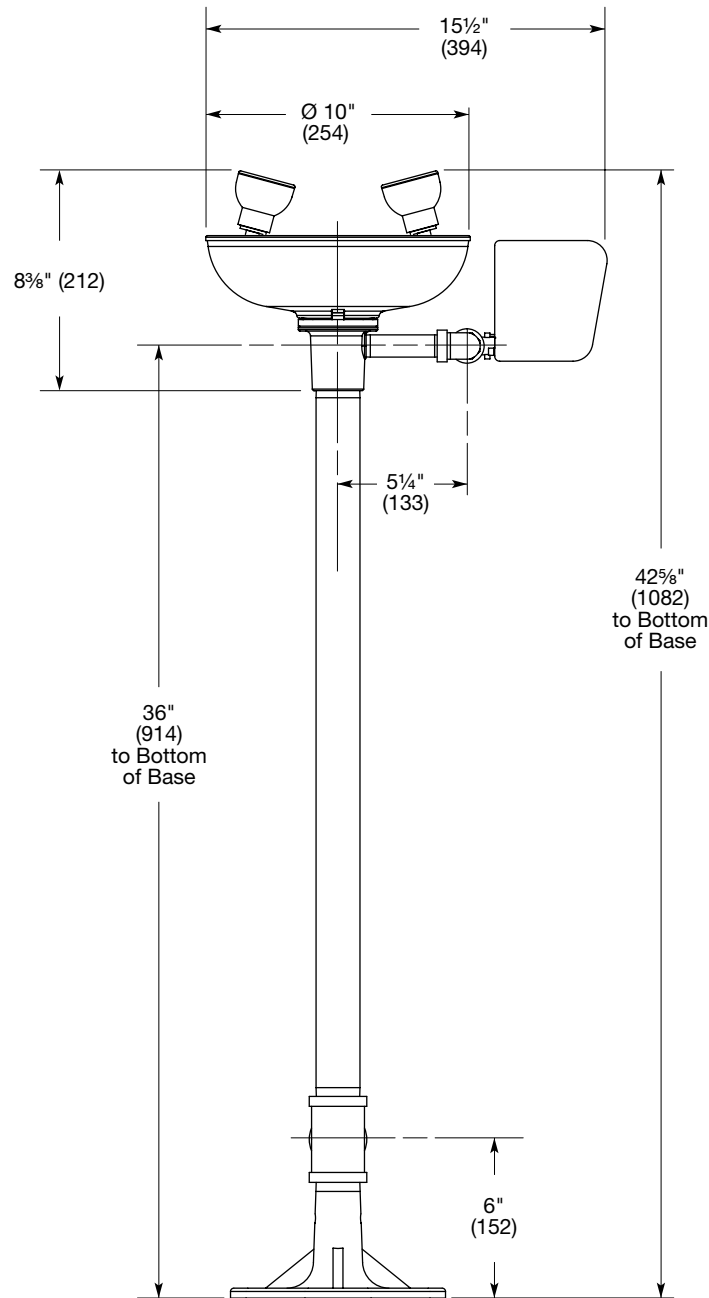

Local codes may require the installation of a backflow prevention valve to complete proper installation. Compliance with local codes is the responsibility of the installer. Valve must be tested annually to verify that it is functioning properly. Backflow prevention valves are not included with the fixture and may be supplied by the contractor or purchased from Bradley Corporation.



All dimensions assume standard thread engagement. Variations in manufacturing allow for +/- ⅛" (3mm) per threaded joint. To find the tolerance of a dimension, add the number of thread joints in between a dimension and multiply it by ⅛" (3mm).