


Designtex
Silicone Element CELLANT®

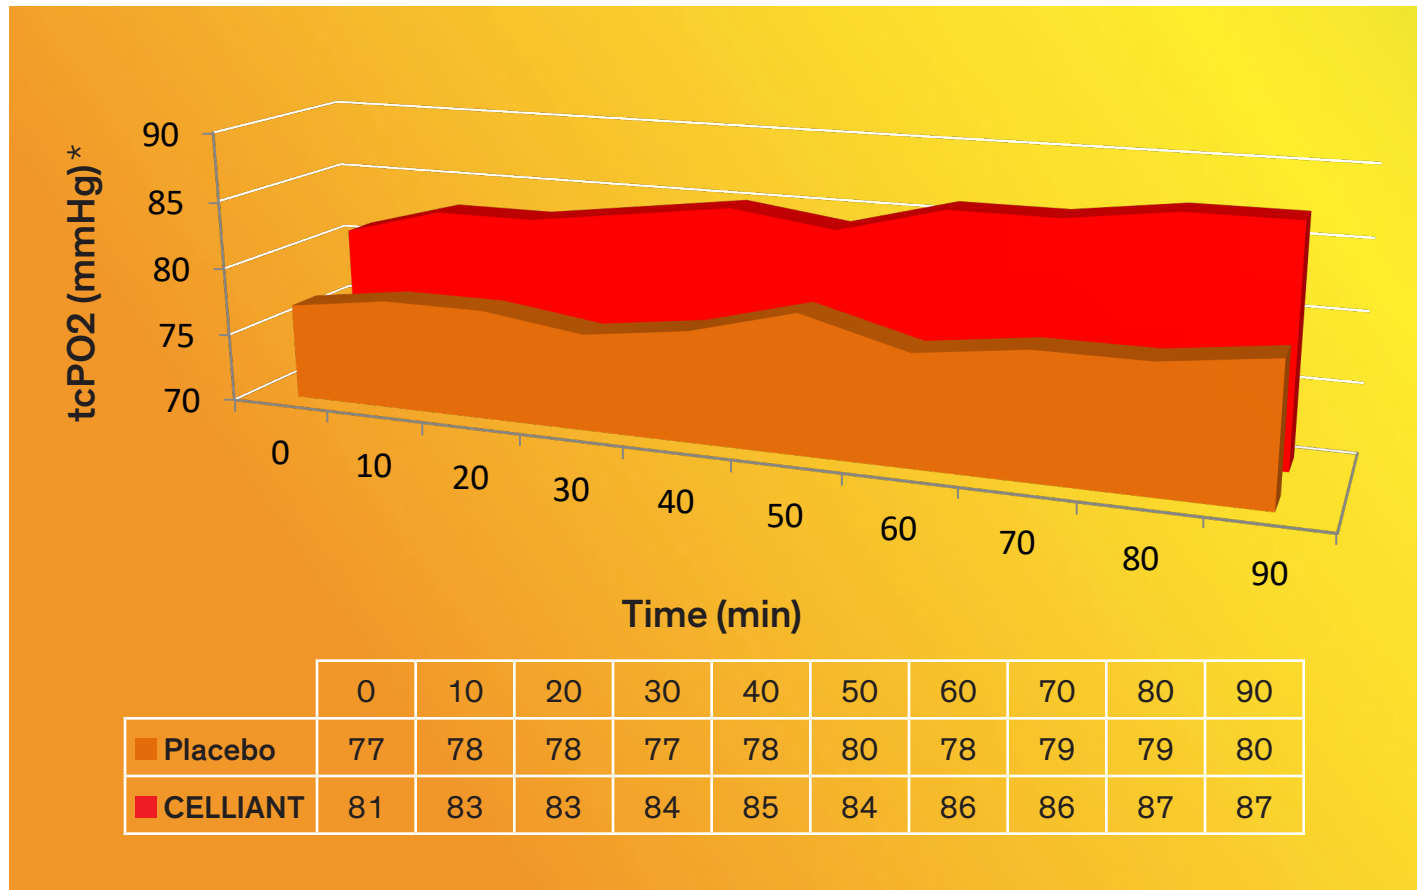

03/22/18

Designtex
Style: 3979 Silicone Element CELLANT

Test Subject

S. Cherry
Age: 48
Sex: Male
Weight: 177 lbs.
Room Temp °C: 23.3

Control Vitals

Skin Temp °C: 32.1
Blood Pressure: 122/66
Heart Rate: 74

CELLANT Vitals

Skin Temp °C: 32.3
Blood Pressure: 125/72
Heart Rate: 70

CELLANT Effect

Maximum increase in tissue oxygenation: 10.2%
Average increase in tissue oxygenation: 7.9%