

CT02 Gamut was tested and met the following flammability requirements:

ASTM E84 Unadhered Class A
CA TB 117-2013
CAN/ULC-S102



Date of Issue: 4/7/2023
 Report Number: 23-000899
 Revision Number:1
 Date Order Received: 03/20/2023

For the Account of: Designtex
 357 County Ave
 Secaucus, NJ 07094

Client's Identification: Gamut
 Stain Resistant

CERTIFICATE OF TESTING

TEST PERFORMED: Standard Method of Test for Surface Burning Characteristics of Building Materials ASTM E 84-21
 Unadhered

TEST RESULTS

	Flame Spread Index	Smoke Developed Index
Gamut	10	85
Reinforced Cement Board	0	0
Red Oak Flooring	100	100

Specimen Data

Time to Ignition	00.07	(min)
Maximum Flame Spread	01.55	(ft)
Time to Maximum Flame Spread	01.10	(min)

ACCEPTANCE CRITERIA

Class	Flame Spread Index	Smoke Development Rating
1 or A	0 - 25	0 - 450 maximum
2 or B	26 - 75	0 - 450 maximum
3 or C	76 - 200	0 - 450 maximum

CONCLUSION Based on the above Results and Acceptance Criteria, the item tested is:

- Class 1 or A
- Class 2 or B
- Class 3 or C
- Unrated

DISCUSSION

This test is certified for ASTM E84 by the Southern Building Code Congress International (SBCCI) as a testing laboratory for Fire and Materials testing, Evaluation Report Number TL-9606 (Commercial Testing), and by the United States Department of Commerce, National Institute of Standards and Technology (NIST), through the National Voluntary Laboratory Accreditation Program (NVLAP) for compliance with criteria set forth in NIST Handbook 150:2001, all requirements of ISO/IEC 17025:2005, and relevant requirements of ISO 9002:1994.

This report is provided for the exclusive use of the client to whom it is addressed. It may be used in its entirety to gain product acceptance from daily-constituted authorities. The test results presented in this report apply only to the samples tested and are not necessarily indicative of apparent identical or similar materials. The client provided sample selection and identification. A sampling plan, if described in the referenced test procedure, was not necessarily followed. This report shall not be used under any circumstance in advertising to the general public.

INTRODUCTION

This report is a presentation of results of a surface flammability test on a material submitted by the client identified above.

The test was conducted in accordance with the most recent version of the ASTM International fire-test-response standard E84 *Surface Burning Characteristics of Building Materials*, sometimes referred to as the Steiner tunnel test. ASTM E84 is an American National Standard (ANSI) and has been approved for use by agencies of the Department of Defense. The ASTM E84 test method is the technical equivalent of UL No. 723. The test is applicable to exposed interior surfaces such as walls and ceilings. The test is conducted with the specimen in the ceiling position with the surface to be evaluated face down toward the ignition source. Thus, specimens shall either be self-supporting by its own structural quality, held in place by added supports along the test surface, or secured from the back side.

This standard is used to measure and describe the response of materials, products, or assemblies to heat and flame under controlled conditions, but does not by itself incorporate all factors required for fire-hazard or fire-risk assessment of the materials, products, or assemblies under actual fire conditions.

Purpose

The purpose of the test is to provide only the comparative measurements of surface flame spread and smoke development of materials with that of select grade red oak and fiber-reinforced cement board, Grade II, under specific fire exposure conditions with the smoke area of heptane used to establish the smoke-developed index. The test exposes a nominal 24-foot long by 20-inch wide test specimen to a controlled air flow and flaming fire adjusted to spread the flame along the entire length of a red oak specimen in 5½ minutes. During the 10-minute test duration, flame spread over the specimen surface are measured and recorded. Test results are calculated relative to red oak, which has an arbitrary rating of 100, and fiber-reinforced cement board, Grade II, which has a rating of 0. The 100 smoke-developed index is calculated using the smoke area of heptane.

The test results are expressed as Flame Spread Index and Smoke-Developed Index. The Flame Spread Index is defined in ASTM E176 as "a number or classification indicating a comparative measure derived from observations made during the progress of the boundary of a zone of flame under defined test conditions." The Smoke-Developed Index, a term specific to ASTM E84, is defined as "a number or classification indicating a comparative measure derived from smoke obscuration data collected during the test for surface burning characteristics." There is not necessarily a relationship between the two measurements.

The method does not provide for measurement of heat transmission through the surface tested, the effect of aggravated flame spread behavior of an assembly resulting from the proximity of combustible walls and ceilings, or classifying a material as noncombustible solely by means of a Flame Spread Index.

The zero reference and other parameters critical to furnace operation are verified on the day of the test by conducting a 10-minute test using 1 / 4-inch fiber-reinforced cement board, Grade IL Periodic tests using NOFMA certified 23/32-inch select grade red oak flooring provide data for the 100 flame spread reference with heptane providing data for calculating the 100 smoke-developed index. These procedures are more fully described in Section 7 of the E84 Standard.

Test Sample

The test sample, selected by the client, is identified in the header section of this report. Three test panels, each measuring two feet wide by eight feet in length, were received. They were physically self-supporting and required no additional sample preparation. The panels were transferred to storage racks and conditioned to equilibrium in an atmosphere with the temperature maintained at 71 ± 2°F and the relative humidity at 50 ± 5 percent. For testing, the panels were placed end-to-end on the ledges of the tunnel furnace to make up the necessary 24-foot test sample and the test conducted with no auxiliary support mechanism.

Test Results

The test results, calculated on the basis of observed flame propagation and the integrated area under the recorded smoke density curve, are presented below. The Flame Spread Index obtained in E84 is rounded to the nearest number divisible by five. Smoke-Developed Indices are rounded to the nearest number divisible by five unless the Index is greater than 200. In that case, the Smoke-Developed Index is rounded to the nearest 50 points. The rounding procedures are more fully described in Sections 9.1, 9.2, and X3 of the E84 Standard. The flame spread and smoke development data are presented graphically at the end of this report.


Classification

The Flame Spread Index and Smoke-Developed Index values obtained by ASTM E84 tests are frequently used by code officials and regulatory agencies in the acceptance of interior finish materials for various applications. The most widely accepted classification system is described in the National Fire Protection Association publication NFPA 101 Life Safety Code, where:

Class A	0 - 25 Flame Spread Index	0 - 450 Smoke-Developed Index
Class B	26 - 75 Flame Spread Index	0 - 450 Smoke-Developed Index
Class C	76 - 200 Flame Spread Index	0 - 450 Smoke-Developed Index

Class A, B, and C correspond to Type I, II, and III respectively in other codes. They do not preclude a material being otherwise classified by the authority of jurisdiction.

CERTIFICATION I certify that the above results were obtained after testing specimen in accordance with the procedures and equipment specified by the standard stated above. These test results were obtained from an outside source



Authorized Signature

Date Order Completed: 04/07/2023

553 76th Street, Byron Center, MI 49315

P: 616-559-6123 E: testlab@applied-lab.com

Page 2 of 2

This laboratory test is not intended to reflect fabric performance under actual conditions. The certification procedure merely measures the performance of samples as received under the predetermined and specific test conditions prescribed by the standard specified. This certificate applies only to the standards or processing identified and to the random sample(s) tested. The test results are representative of the qualities of the piece or lot only to the extent the sample tested is representative of the piece or lot.

Our reports and letters are for the exclusive use of the customer to whom they are addressed and they and the corporation named on the reverse are not to be used under any circumstances without prior written approval. Samples will not be retained, unless specified by the customer. Retained samples will be kept a maximum time of one year unless a specific retention period is necessary.



Date of Issue: 9/24/2019
 Report Number: 19-004691
 Revision Number: 1
 Date Order Received: 08/27/2019

For the Account of: **Designtex**
 357 County Ave
 Secaucus, NJ 07094

Client's Identification: **Gamut**
Stain Repellent

CERTIFICATE OF TESTING

TEST PERFORMED: California Technical Bulletin 117: June 2013 – Requirements, Test Procedure and Apparatus for Testing the Smolder Resistance of Materials Used in Upholstered Furniture – Cover Fabric Test

TEST RESULTS

	Specimen	Char Length (in)	Extinguished in 45 Minutes
Initial Test	1	0.7	Y
	2	0.8	Y
	3	0.8	Y

NOTES

Test Conditions: 70 ±5°F, 50 ±5% Relative Humidity

Dev-009: Used SRM 1196 Equivalent **YES**
 Lot # 19110130312

ACCEPTANCE CRITERIA

A material is considered to pass or fail based on the following criteria:

1. A single mock-up test specimen fails to meet the requirements of this test procedure if any of the following criteria occurs:
 - a. The mock-up test specimen continues to smolder after the 45 minute test duration
 - b. A vertical char length of more than 1.8 inches (45mm) develops on the cover fabric
 - c. The mock-up test specimen transitions to open flaming
2. The cover fabric passes the test if three initial mock-up specimens pass the test, i.e. the cigarettes burn their full length and are no longer smoldering
3. If more than one initial specimen fails, the cover fabric fails the test
4. If any one of the three initial specimens fails, repeat the test on additional three specimens
5. If all three additional specimens pass the test, the cover fabric passes the test. If any one of the additional three specimens fails, the cover fabric fails the test

CONCLUSION Based on the above Results and Acceptance Criteria, the item tested is:

- Pass
- Fail

CERTIFICATION I certify that the above results were obtained after testing specimen in accordance with the procedures and equipment specified by the standard stated above.

Berta Stiver

Authorized Signature

Date Order Completed: 09/23/2019



Tested For: Teesha Prezeau	Phone: (201) 917-7738	Received: 6/10/2025
Designtex	Fax:	Completed: 6/16/2025
357 County Avenue	Mobile:	Code: B
Secaucus, NJ 07094	PO#:	Test Report: 3-59647-0-RV
USA	Email: tprezeau@designtex.com	

Key Test: CAN/ULC-S102.2

90

Client's Identification:

Style: Polyester: Plain Weave, 14.5-16.5 oz. Composition 100% Polyester. Finish:. Weight 16.5 oz/lyd.

LE: 2018(R24) V 08/24 BG

PC: 23±3°C 50%±5% RH - ME

CODE: I=1375 F=2925 CLEAN=1000

TEST PERFORMED: CAN/ULC-S102.2-18 - Standard Method of Test for Surface Burning Characteristics of Flooring, Floor Covering and Miscellaneous Materials

TEST CONDUCTED:

- Indicative
 Formal

PRODUCT CATEGORY: Composite Panel Material
 Textile Type Product
 Vinyl Type Product

BRIEF DESCRIPTION OF TEST METHOD: The method is designed to determine the relative burning characteristics of materials under specific test conditions. Results of less than three identical specimens are expressed in terms of Flame Spread Value (FSV) and Smoke Developed Value (SDV). Results of three or more replicate tests on identical specimens produce average values expressed as Flame Spread Rating (FSR) and Smoke Developed Classification (SDC).

SUMMARY OF TEST PROCEDURE: The tunnel is preheated to 85°C, as measured by the backwall-embedded thermocouple located 7090 mm downstream of the burner ports, and allowed to cool to 40°C, as measured by the backwall-embedded thermocouple located 4000 mm from the burners. At this time the tunnel lid is raised, and the test sample is placed along the floor of the tunnel so as to form a continuous surface and then the lid is lowered. Upon ignition of the gas burners, the flame spread distance is observed and recorded every second. Flame spread distance versus time is plotted, ignoring any flame front recessions. Calculations are based on comparison with flame spread characteristics of select red oak, determined in calibration trials and arbitrarily established as 100. If the area under the curve (AT) is less than or equal to 29.7 m²min, FSV=1.85·AT; if greater, FSV=1640/(59.4-AT). The Smoke Developed Value is determined by comparing the area under the obscuration curve for the test sample to that of inorganic reinforced cement board and red oak, established as 0 and 100, respectively.

The results contained in this report relate only to the item(s) tested. The test report shall not be reproduced except in full, without written approval from SGS North America.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/terms-e-document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for a maximum of 45 days only.



Tested For: Teesha Prezeau
 Designtex
 357 County Avenue
 Secaucus, NJ 07094
 USA

Phone: (201) 917-7738
Fax:
Mobile:
PO#:
Email: tprezeau@designtex.com

Received: 6/10/2025
Completed: 6/16/2025
Code: B
Test Report: 3-59647-0-RV

Key Test: CAN/ULC-S102.2

90

SAMPLE PREPARATION:

- The sample consisted of two sections of materials, each approximately 445 mm in width by 3658 mm in length. butted together to form the requisite specimen length. The specimen was free laid (no adhesive) on top of a 6 mm fiberglass reinforced cement board substrate.
- Adhered to IRC: The test specimen was bonded to ¼" Inorganic Reinforced Cement (IRC) boards.
- Adhered to Gypsum: The test specimen was bonded to 5/8" thick Type X gypsum board.
- Other: The test specimen was not adhered to any substrate. Instead, it was laid free over a 6mm fiber cement paper. The 24 ft. length was comprised of three 8 ft. sections butted end to end.

ADHESIVE (applied by SGS North America): No
 Yes - specify

REPORTED AS:

- INDICATIVE (Single Specimen Test):
 Flame Spread Value (FSV):
 Smoke Developed Value (SDV):
- FORMAL (Average Value of three replicate tests):
 Flame Spread Rating (FSR): 20
 Smoke Developed Classification: 205

The results contained in this report relate only to the item(s) tested. The test report shall not be reproduced except in full, without written approval from SGS North America.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/terms-e-document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for a maximum of 45 days only.



Tested For: Teesha Prezeau
 Designtex
 357 County Avenue
 Secaucus, NJ 07094
 USA

Phone: (201) 917-7738
Fax:
Mobile:
PO#:
Email: tprezeau@designtex.com

Received: 6/10/2025
Completed: 6/16/2025
Code: B
Test Report: 3-59647-0-RV

Key Test: CAN/ULC-S102.2

90

RESULTS:

Specimen #	Flame Spread Value	Smoke Developed Value	Burn Distance (meters)	Time (seconds)
1	18.4	197.5	1.2	154
2	19.0	202.9	1.4	201
3	16.4	218.7	1.2	252

OBSERVATIONS:

1. No unusual observations
2. No unusual observations
3. No unusual observations

REMARKS: None.

ACCEPTANCE CRITERIA: None cited.

CONCLUSION: Not applicable.

CERTIFICATION: I certify that the above results were obtained after testing specimens in accordance with the procedures and equipment specified above.

Signed by:

 9/8/2025
 BC915566495A4BD...

AUTHORIZED SIGNATURE
 SGS NORTH AMERICA
 /jo/jl

RV: 9/8/25; bg



Enclosure: Graphs

The results contained in this report relate only to the item(s) tested. The test report shall not be reproduced except in full, without written approval from SGS North America.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/terms-e-document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for a maximum of 45 days only.



Program: Steiner Tunnel (Version 1.0.3.0)

Test Method : CAN/ULC - S102.2
 Report # : 3-59647-0-RV-B
 Test Date : 6/16/2025
 Client : Designtex
 Operator : Ashley Mattern
 Details of Preparation : The test specimen was not adhered to any substrate. Instead, it was free laid over a 6mm fiber cement paper. The 24 ft. length was comprised of three 8 ft. sections butted end to end.
 Observations : No unusual observations.

	Specimen 1	Specimen 2	Specimen 3
Area Under Flame Curve (m min)	9.9	10.2	8.9
Flame Spread Value	18.4	19.0	16.4
Ignition Time (mm:ss)	00:55	02:14	01:34
Area Under Smoke Curve (%A min)	62.4	64.1	69.1
Smoke Developed Value	197.5	202.9	218.7
Total Gas Flow (L)	1593.4	1595.9	1593.5
Maximum Flame Front Achieved (m)	1.2 @ 154s	1.4 @ 201s	1.2 @ 252s

Flame Spread Rating : 20
Smoke Developed Classification : 205

CERTIFICATION : I certify that the above results were obtained after testing the specimens in accordance with the procedures and equipment specified by CAN/ULC - S102.2


Ashley Mattern

 AUTHORIZED SIGNATURE




Test Method : CAN/ULC - S102.2
Test Report # : 3-59647-0-B

Flame Progression

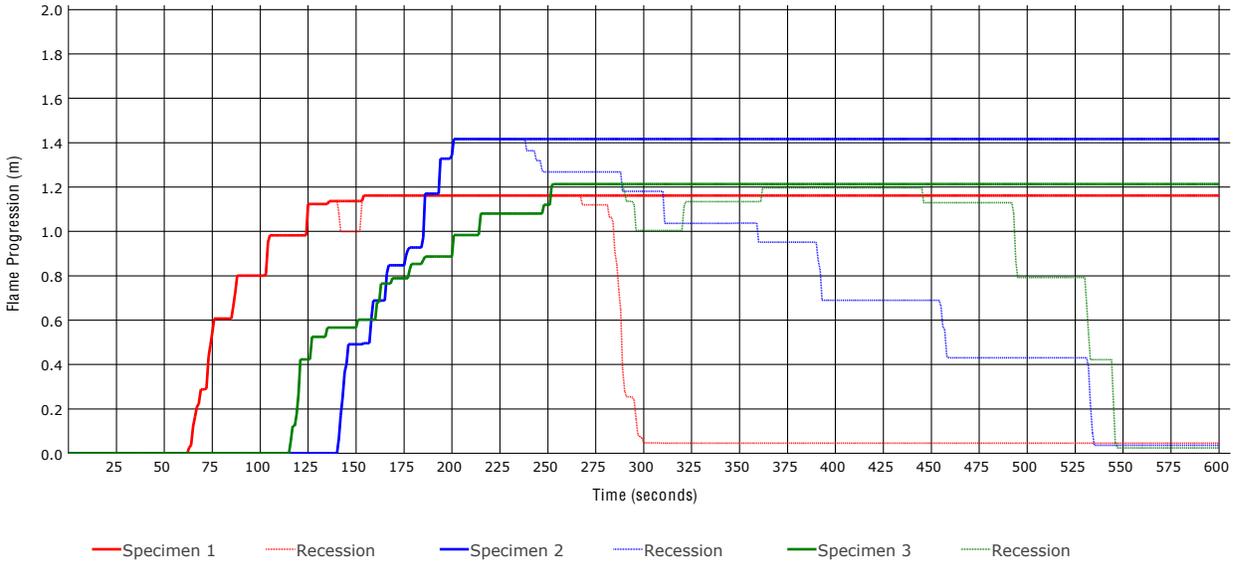

Smoke Density

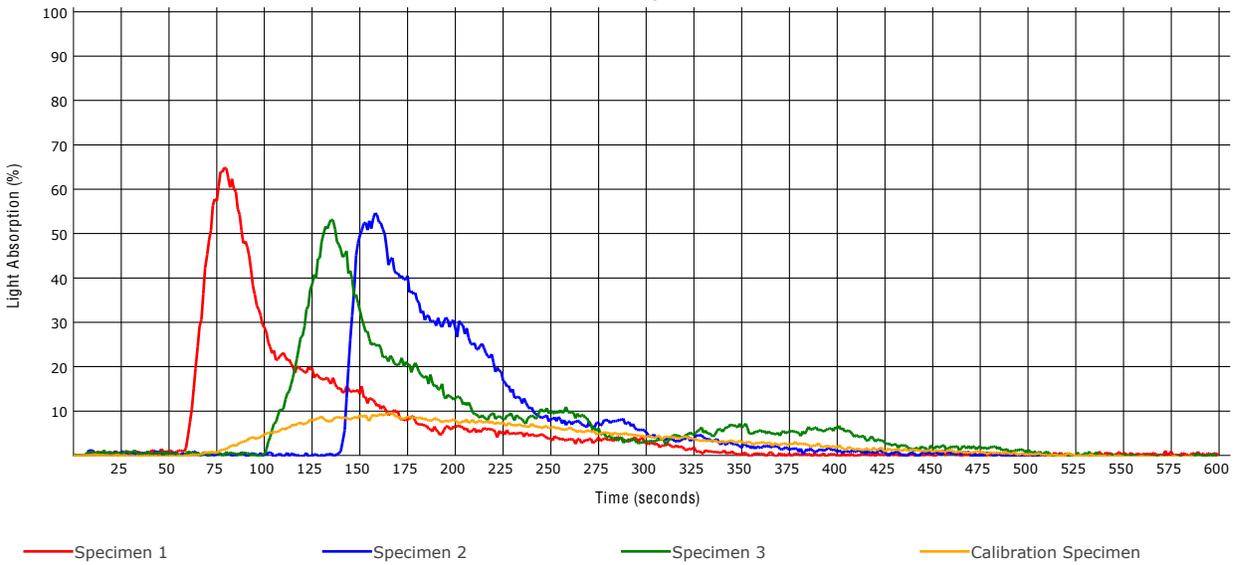



Test Method : CAN/ULC - S102.2
Test Report # : 3-59647-0-B

