

**CT34 Everywhere Texture was tested and met the following flammability requirements:**

ASTM E84 Unadhered Class A  
CA TB 117-2013  
CAN/ULC-S102



Received:08/02/2017	Completed:08/04/2017	Letter: N1	RM	P.O.#:	Test Report #:	3-20494-1-
---------------------	----------------------	------------	----	--------	----------------	------------

Client's Identification	Style: 4147 Everywhere Content: 100% Polyester. Color: Light Blue. Product End Use: Upholstery Panel. Texture					
-------------------------	--	--	--	--	--	--

Tested For: <b>Megan Rietzke</b> Designtex 200 Varick Street, 8 fl. New York, NY 10014	Key Test: ASTM E 84/ACT  Tel: 1-(212)-886-8137 Fax: 1-( )- -	1275  Ext:
---	---	------------------

Test Category: Tunnel Test      Specifier: ACT      NTR 8/15      LE 2015; V 08/15  
 PC: ME      dl/SM

TEST PERFORMED: ASTM E 84 - Standard Test Method for Surface Burning Characteristics of Building Materials \* --

As cited by the ACT Voluntary Performance Guidelines (January 2015)

APPROXIMATE THICKNESS OF SPECIMEN (as measured by Govmark): 0.036"

PRODUCT CATEGORY:

- Direct Glue Wallcoverings
- Wrapped Panels & Upholstered Walls
- Other Products: \_\_\_\_\_

\* NOTE: Textile or expanded vinyl wallcoverings classified by this procedure are limited to use in sprinklered areas in certain public occupancies. If textile or expanded vinyl wallcoverings are used in non-sprinklered areas, the NFPA 265 corner fire test is mandated.

For other interior finish products in non-sprinklered areas, a room corner fire test also applies. This would be NFPA 286.

SPECIMEN MOUNTING:

- Self Supporting: The test specimen, the face of which was 23" ± 1" x 24', was such that it remained in position in the tunnel during the fire test, and no additional support was required.
- Adhered to IRC: The test specimen was bonded to three 1/4" IRC (Inorganic Reinforced Cement) boards (a cement asbestos substitute) to form a test specimen the face of which was 23" ± 1" x 24'.
- Adhered to Gypsum: The test specimen was adhered to 5/8" thick Type X gypsum board, to form a test specimen the face of which was 23" ± 1" x 24'.
- Unadhered: The 23" ± 1" x 24' specimen was not adhered to any substrate. Instead, it was laid over a 2" hexagonal wire mesh screen and 1/4" rods.
- Other: \_\_\_\_\_



Received:08/02/2017 Completed:08/04/2017 Letter: N1 RM P.O.#: Test Report #: 3-20494-1-

Client's Identification Style: Everything Plain. Content: 100% Polyester. Color: Light Blue. Product End Use: Upholstery Panel.

Tested For: **Megan Rietzke** Key Test: ASTM E 84/ACT 1275  
 Designtex  
 200 Varick Street, 8 fl. Tel: 1-(212)-886-8137 Ext:  
 New York, NY 10014 Fax: 1-( )- -

RESULTS:

Flame Spread Index: 0  
 Smoke Developed: 10

ACCEPTANCE CRITERIA:

	Flame Spread Index	Smoke Developed
	-----	-----
Class A	0 - 25	450 or less

NOTE: Class A is also known as Class 1, and may be so specified in some Codes.

CONCLUSION: Based on the above Results and Acceptance Criteria the item tested:

Complies;  Does not comply

REMARKS: None

DATA SUMMARY:

Time to Ignition: 0 minutes  
 Maximum Flame Spread "Distance": 0 feet  
 Maximum Flame Spread "Time": 0 minutes


CERTIFICATION: I certify that the above results were obtained after testing specimens in accordance with the procedures and equipment specified above.

  
 -----  
 AUTHORIZED SIGNATURE  
 GOVMARK  
 /pm /mo

**Phyllis Pettit**  
 AUG 15 2017


Test Method : ASTM E84  
Test Report # : 3-20494-1-N1  
Date : 8/4/2017  
Client : Designtex  
Operator : Rick McDonough  
Details of Preparation : Unadhered. Specimen laid over 2" hexagonal wire mesh and 1/4" rods. One 16 foot long section and one 8 foot long section butted end to end  
Observations : No ignition. Material melted away. Heavy dripping.

Area Under Flame Curve (ft min) : 0.01  
Raw Flame Spread Index (ft min) : 0.00  
Rounded Flame Spread Index (ft min) : **0**  
Ignition Time : **No Ignition**  
Area Under Smoke Curve (%A min) : 5.51  
Raw Smoke-Developed Index : 7.82  
Rounded Smoke-Developed Index : **10**  
Total Gas Flow(L) : 1401.7  
Total Gas Flow(ft<sup>3</sup>) : 49.5  
Maximum Flame Front Achieved(ft) : 0 (@0s)

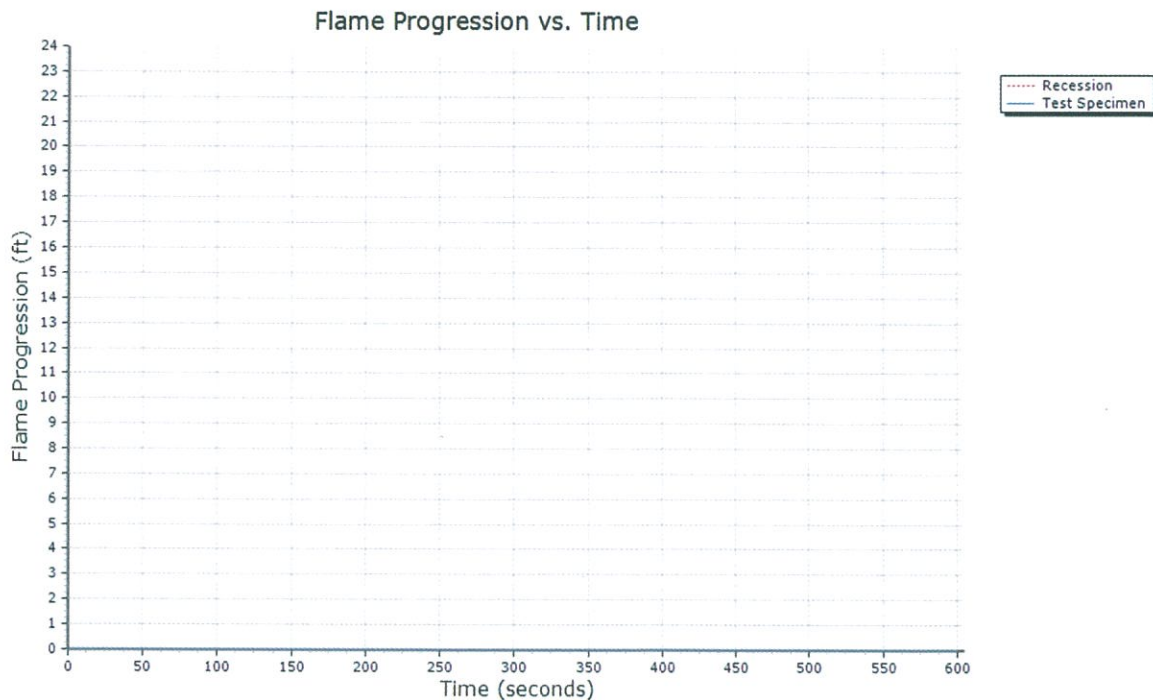

Test Method : ASTM E84  
Test Report # : 3-20494-1-N1

Light Absorption vs. Time

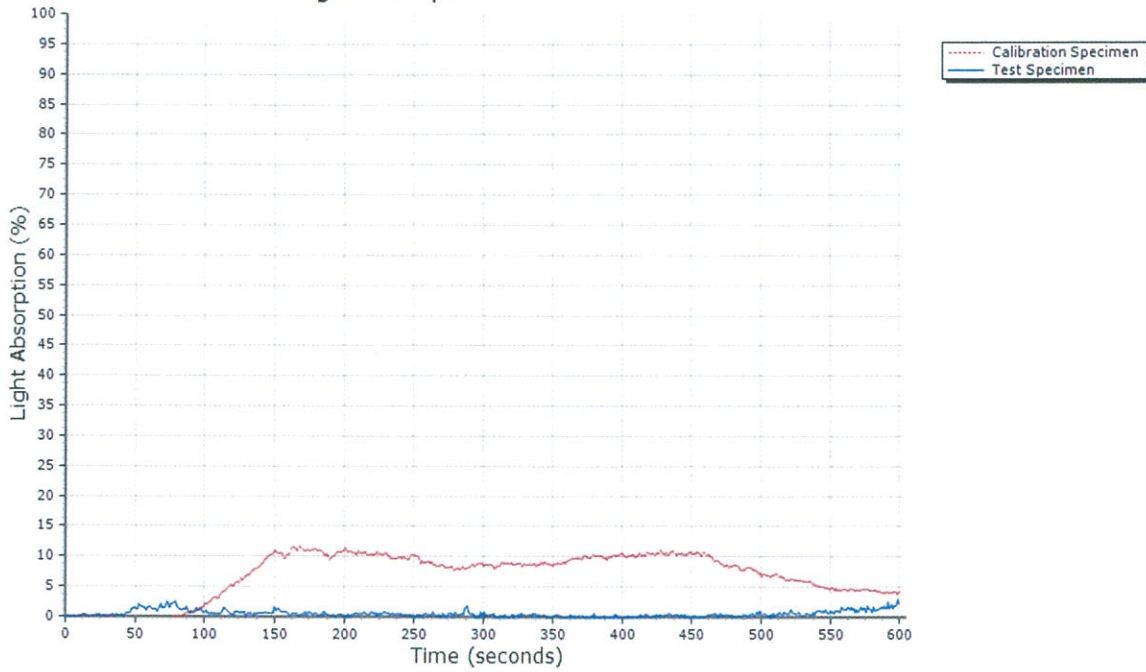

## ISO/IEC 17025 Third Party Test Report

DATE: September 22, 2021

FILE: DESTEX.A091521A

CLIENT: Designtex Product Services  
357 County Ave  
Secaucus, NJ 07094

ATTN: Teesha Prezeau

### SAMPLE IDENTIFIED BY CLIENT AS:

Fabric Submitted  
Name: Everywhere Texture 4147  
Quality: 16.5 oz., lin yd 55"  
100% Polyester  
Color Gold

### TEST PROCEDURE:

### TEST RESULTS:

#### CALIFORNIA TECHNICAL BULLETIN 117-2013 SECTION 1 COVER FABRIC TEST

	<u>CHAR LENGTH (mm)</u>
Specimen #1:	20
Specimen #2:	22
Specimen #3:	21

- a) The mock-up test specimen continues to smolder after the 45-minute test duration: **NO**  
b) A char develops more than 1.8 inches (45 mm) in any direction from the cigarette on the cover fabric measured from its nearest point: **NO**  
c) The mock-up test specimen transitions to open flaming: **NO**

### RESULTS: PASS

- A material is considered to pass or fail based on the following criteria:
1. A single mock-up test specimen fails to meet the requirements of this test procedure if any of the following criteria occurs:
    - a) The mock-up test specimen continues to smolder after the 45-minute test duration.
    - b) A char develops more than 1.8 inches (45 mm) in any direction from the cigarette on the cover fabric measured from its nearest point.
    - c) The mock-up test specimen transitions to open flaming.
  2. The cover fabric passes the test if three initial mock-up specimens pass the test, i.e., the cigarettes burn their full length and the mock-ups are no longer smoldering.
  3. If more than one initial specimen fails, the cover fabric fails the test.
  4. If any one of the three initial specimens fails, repeat the test on an additional three specimens.
  5. If all three additional specimens pass the test, the cover fabric passes the test. If any one of the three additional specimens fails, the cover fabric fails the test.

Signed For The Company By

*Joseph Lin / ADV.*  
Joseph Lin  
Laboratory Manager



*Stacy Sadowy*  
Stacy Sadowy  
Quality Assurance Manager

CS/09



<b>Tested For:</b> Teesha Prezeau	<b>Phone:</b> (201) 917-7738	<b>Received:</b> 6/10/2025
DesignTex	<b>Fax:</b>	<b>Completed:</b> 6/13/2025
357 County Avenue	<b>Mobile:</b>	<b>Code:</b> A
Secaucus, NJ 07094	<b>PO#:</b>	<b>Test Report:</b> 3-59646-0-RV
USA	<b>Email:</b> tprezeau@designtex.com	

**Key Test:** CAN/ULC-S102.2

90

**Client's Identification:**

Style: Polyester: Plain Weave, 12.5-14.5 oz. Composition: 100% Polyester. Finish: None. Weight 13.5 oz/lyz. End Use: Panel

LE: 2018(R24) V 08/24 BG

PC: 23±3°C 50%±5% RH - ME

CODE: I=1375 F=2925 CLEAN=1000

TEST PERFORMED: CAN/ULC-S102.2-18 - Standard Method of Test for Surface Burning Characteristics of Flooring, Floor Covering and Miscellaneous Materials

**TEST CONDUCTED:**

- Indicative  
 Formal

PRODUCT CATEGORY:  Composite Panel Material  
 Textile Type Product  
 Vinyl Type Product

**BRIEF DESCRIPTION OF TEST METHOD:** The method is designed to determine the relative burning characteristics of materials under specific test conditions. Results of less than three identical specimens are expressed in terms of Flame Spread Value (FSV) and Smoke Developed Value (SDV). Results of three or more replicate tests on identical specimens produce average values expressed as Flame Spread Rating (FSR) and Smoke Developed Classification (SDC).

**SUMMARY OF TEST PROCEDURE:** The tunnel is preheated to 85°C, as measured by the backwall-embedded thermocouple located 7090 mm downstream of the burner ports, and allowed to cool to 40°C, as measured by the backwall-embedded thermocouple located 4000 mm from the burners. At this time the tunnel lid is raised, and the test sample is placed along the floor of the tunnel so as to form a continuous surface and then the lid is lowered. Upon ignition of the gas burners, the flame spread distance is observed and recorded every second. Flame spread distance versus time is plotted, ignoring any flame front recessions. Calculations are based on comparison with flame spread characteristics of select red oak, determined in calibration trials and arbitrarily established as 100. If the area under the curve (AT) is less than or equal to 29.7 m<sup>2</sup>min, FSV=1.85·AT; if greater, FSV=1640/(59.4-AT). The Smoke Developed Value is determined by comparing the area under the obscuration curve for the test sample to that of inorganic reinforced cement board and red oak, established as 0 and 100, respectively.

The results contained in this report relate only to the item(s) tested. The test report shall not be reproduced except in full, without written approval from SGS North America.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/terms-e-document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for a maximum of 45 days only.



**Tested For:** Teesha Prezeau  
 Designtex  
 357 County Avenue  
 Secaucus, NJ 07094  
 USA

**Phone:** (201) 917-7738  
**Fax:**  
**Mobile:**  
**PO#:**  
**Email:** tprezeau@designtex.com

**Received:** 6/10/2025  
**Completed:** 6/13/2025  
**Code:** A  
**Test Report:** 3-59646-0-RV

**Key Test:** CAN/ULC-S102.2

90

#### SAMPLE PREPARATION:

- The sample consisted of two sections of materials, each approximately 445 mm in width by 3658 mm in length butted together to form the requisite specimen length. The specimen was free laid (no adhesive) on top of a 6 mm fiberglass reinforced cement board substrate.
- Adhered to IRC: The test specimen was bonded to 1/4" Inorganic Reinforced Cement (IRC) boards.
- Adhered to Gypsum: The test specimen was bonded to 5/8" thick Type X gypsum board.
- Other: The test specimen was not adhered to any substrate. Instead, it was free laid over a 6 mm fiber cement paper. The 24 ft. length was comprised of three 8 ft. sections butted end to end.

ADHESIVE (applied by SGS North America):  No  
 Yes - specify

#### REPORTED AS:

- INDICATIVE (Single Specimen Test):  
 Flame Spread Value (FSV):  
 Smoke Developed Value (SDV):
- FORMAL (Average Value of three replicate tests):  
 Flame Spread Rating (FSR): 15  
 Smoke Developed Classification: 215

The results contained in this report relate only to the item(s) tested. The test report shall not be reproduced except in full, without written approval from SGS North America.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/terms-e-document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for a maximum of 45 days only.



**Tested For:** Teesha Prezeau  
 Designtex  
 357 County Avenue  
 Secaucus, NJ 07094  
 USA

**Phone:** (201) 917-7738  
**Fax:**  
**Mobile:**  
**PO#:**  
**Email:** tprezeau@designtex.com

**Received:** 6/10/2025  
**Completed:** 6/13/2025  
**Code:** A  
**Test Report:** 3-59646-0-RV

**Key Test:** CAN/ULC-S102.2

90

**RESULTS:**

Specimen #	Flame Spread Value	Smoke Developed Value	Burn Distance (meters)	Time (seconds)
1	5.5	206.7	0.9	522
2	19.0	223.3	1.3	152
3	19.8	221.6	1.4	183

**OBSERVATIONS:**

1. No unusual observations
2. No unusual observations
3. No unusual observations

**REMARKS:** None.

**ACCEPTANCE CRITERIA:** None cited.

**CONCLUSION:** Not applicable.

**CERTIFICATION:** I certify that the above results were obtained after testing specimens in accordance with the procedures and equipment specified above.

Signed by:

*Branden Gallagher*

9/8/2025

BC915566495A4BD...

AUTHORIZED SIGNATURE  
 SGS NORTH AMERICA  
 /jo/jl

RV: 9/8/25; bg



Enclosure: Graphs

The results contained in this report relate only to the item(s) tested. The test report shall not be reproduced except in full, without written approval from SGS North America.

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/terms-e-document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for a maximum of 45 days only.



Program: Steiner Tunnel (Version 1.0.3.0)

Test Method : CAN/ULC - S102.2  
 Report # : 3-59646-0-RV-A  
 Test Date : 6/13/2025  
 Client : Designtex  
 Operator : Jimmy Rosinsky  
 Details of Preparation : The test specimen was not adhered to any substrate. Instead, it was free laid over a 6mm fiber cement paper. The 24 ft. length was comprised of three 8 ft. sections butted end to end.  
 Observations : No unusual observations

	Specimen 1	Specimen 2	Specimen 3
<b>Area Under Flame Curve (m min)</b>	3.0	10.3	10.7
<b>Flame Spread Value</b>	5.5	19.0	19.8
<b>Ignition Time (mm:ss)</b>	01:00	01:36	01:15
<b>Area Under Smoke Curve (%A min)</b>	65.3	70.6	70.0
<b>Smoke Developed Value</b>	206.7	223.3	221.6
<b>Total Gas Flow (L)</b>	1595.9	1593.8	1595.9
<b>Maximum Flame Front Achieved (m)</b>	0.9 @ 522s	1.3 @ 152s	1.4 @ 183s

**Flame Spread Rating** : 15  
**Smoke Developed Classification** : 215


CERTIFICATION : I certify that the above results were obtained after testing the specimens in accordance with the procedures and equipment specified by CAN/ULC - S102.2

*Jimmy Rosinsky*  
 \_\_\_\_\_  
 AUTHORIZED SIGNATURE




Test Method : CAN/ULC - S102.2  
Test Report # : 3-59646-0-A

### Flame Progression

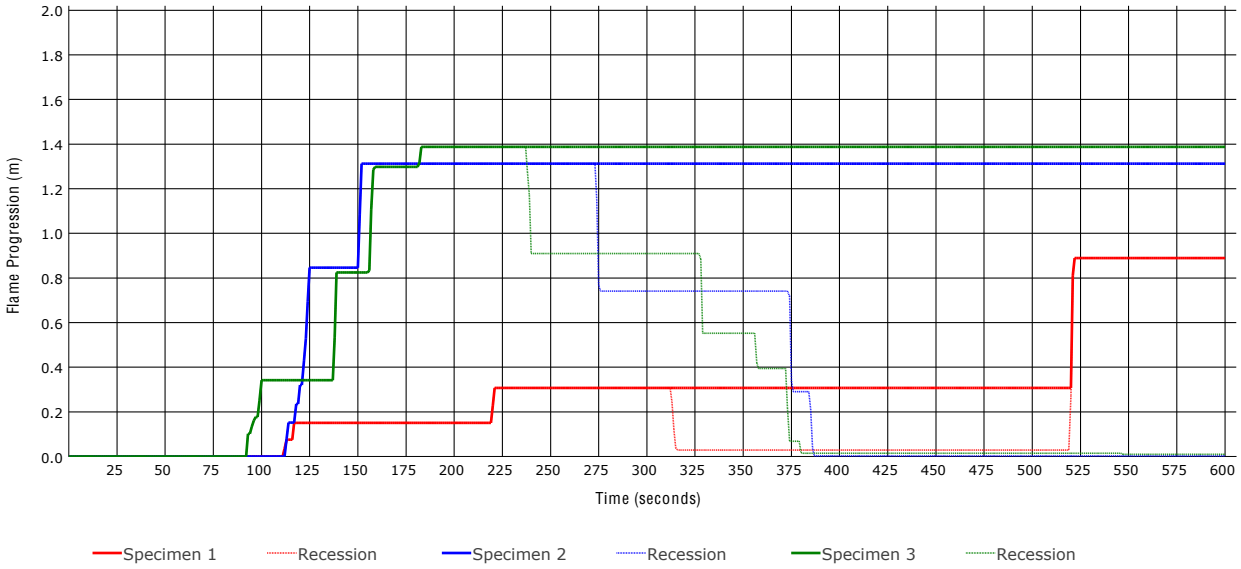

### Smoke Density

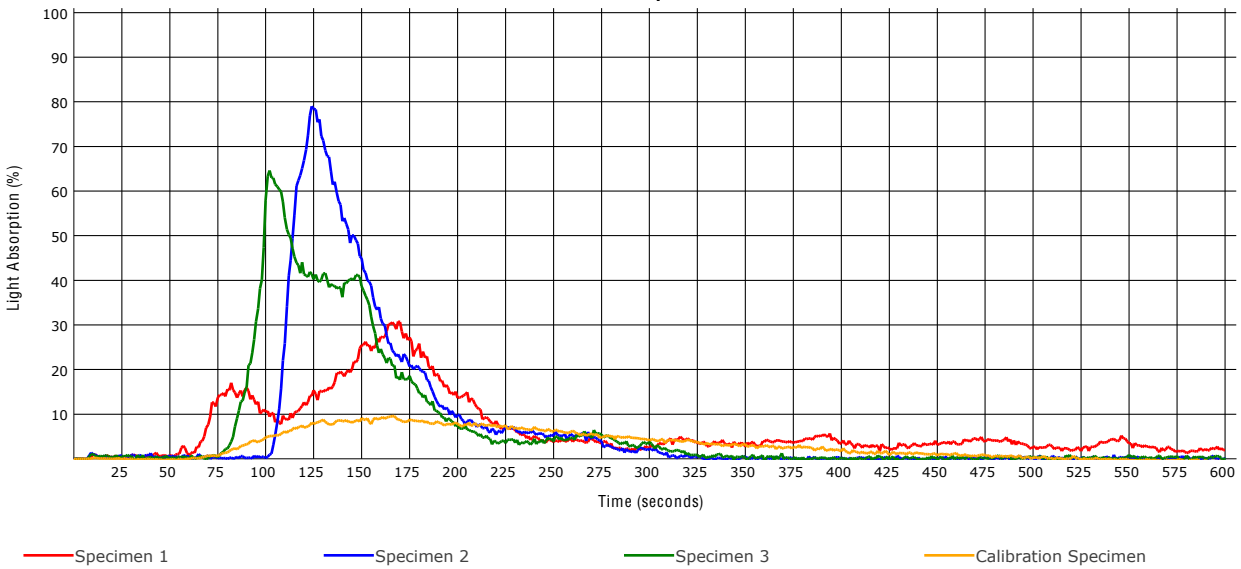



Test Method : CAN/ULC - S102.2  
Test Report # : 3-59646-0-A

